


VAULT INTERIOR

PIPE SLEEVE ID
EQUAL TO PIPE
OD +1" MIN
SEE NOTE 1

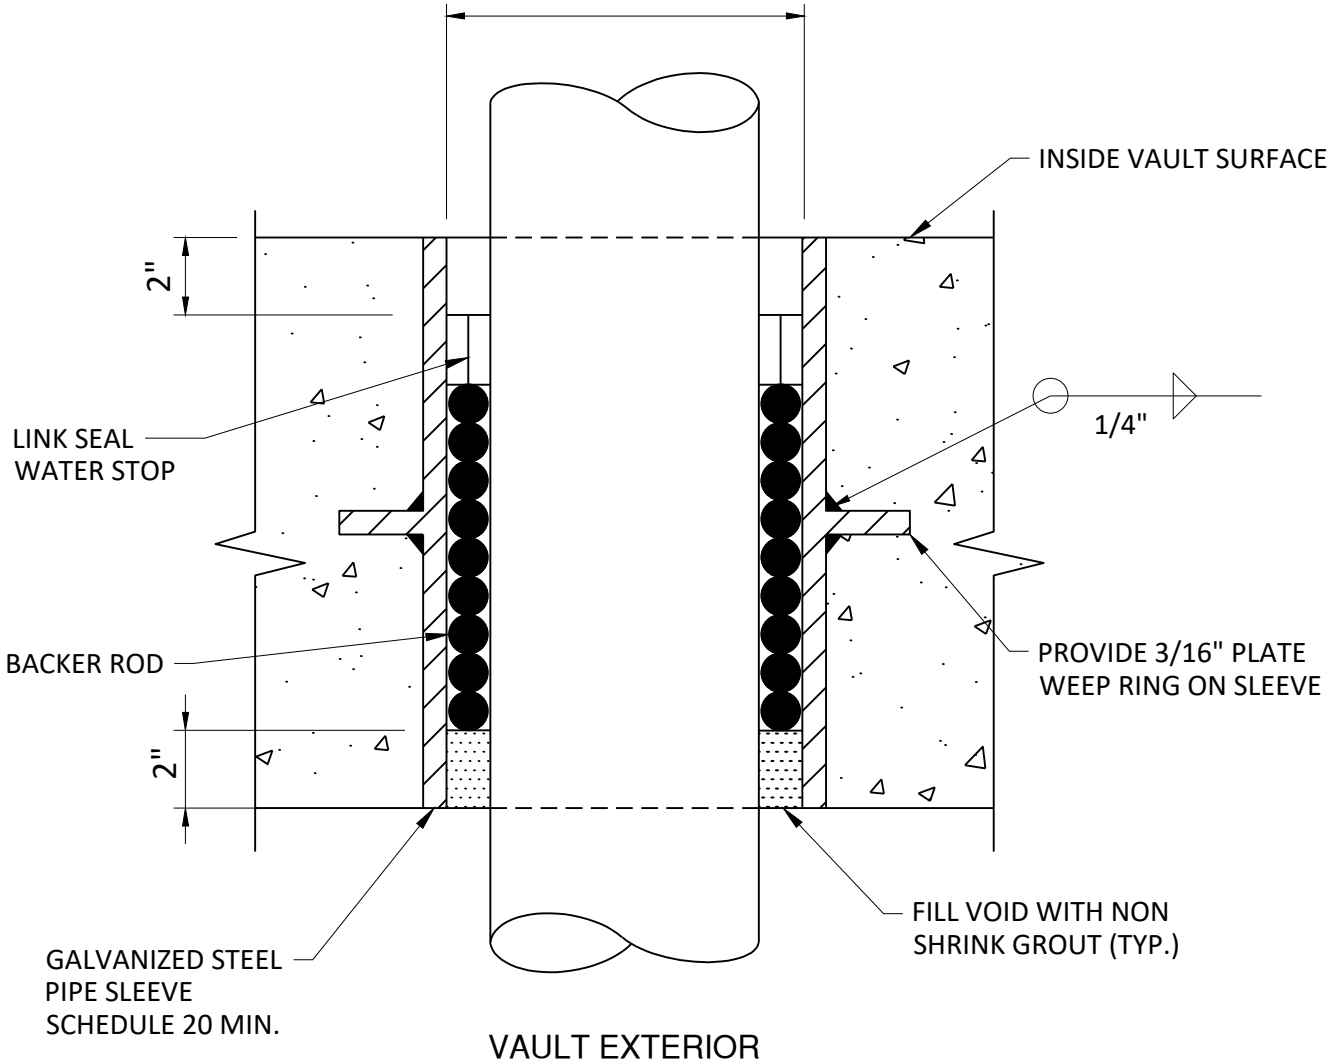

NOTES:

1. CONTRACTOR TO COORDINATE PIPE SLEEVE O.D. WITH MANUFACTURER.
2. INSTALL BACKER ROD AS NEEDED BETWEEN LINK SEAL AND NON-SHRINK GROUT SEAL.



NEW BRAUNFELS UTILITIES
WATER SYSTEMS ENGINEERING

DRAWN BY:
EWL
APPROVED BY:
A. WILLARD

DRAWING DATE:
2/1/24

STANDARD DRAWING:

VAULT PIPE PENETRATION DETAIL

UPDATED:

SCALE:
N.T.S.

SHEET:
1 OF 1

DRAWING NO.

207