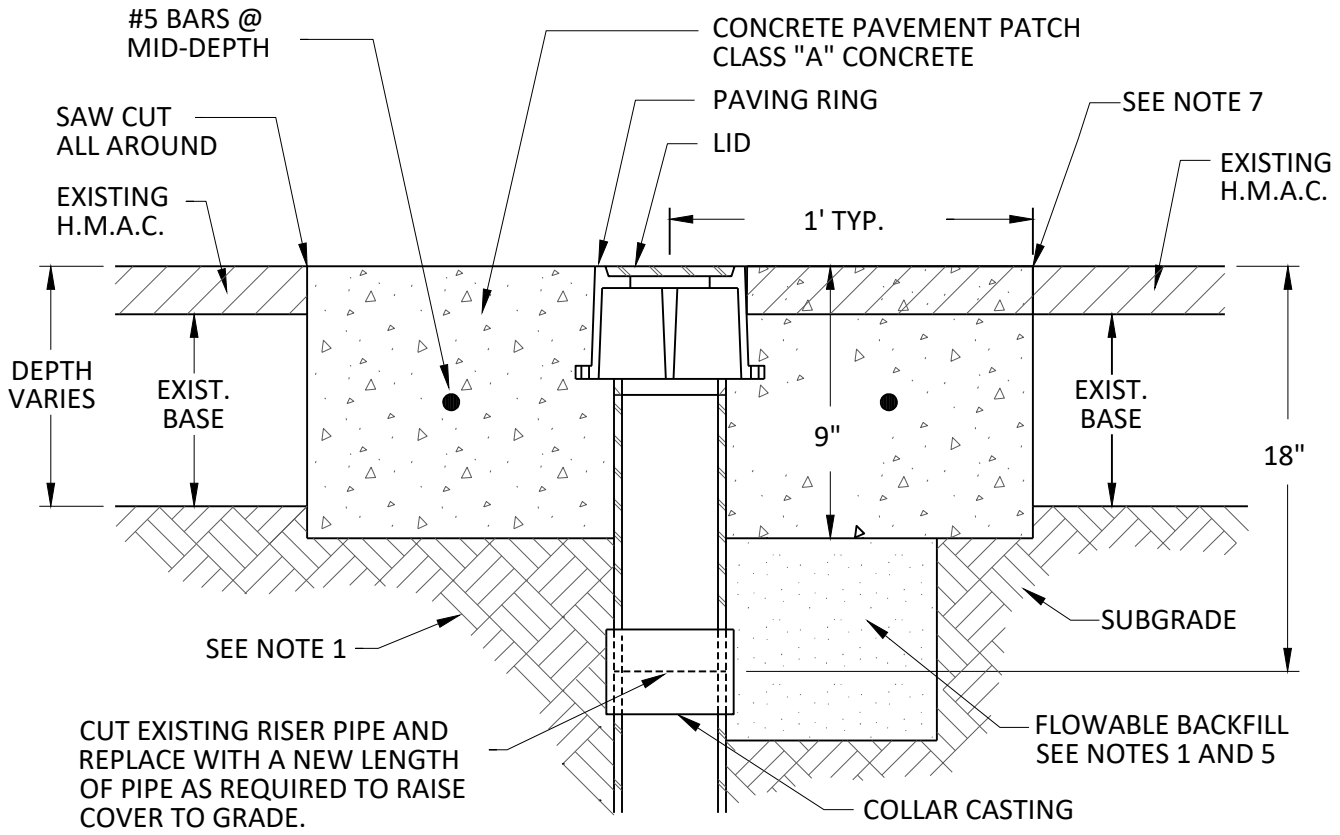

SECTION B-B

NOTES:

1. SUBGRADE SHALL BE COMPACTED AS PER SPECIFICATIONS.
2. VALVE CASTINGS SHALL BE ADJUSTED TO GRADE AFTER FINAL LIFT OF OVERLAY IS IN PLACE.
3. CLEAN VALVE BOX OF ALL DEBRIS DOWN TO THE BASE OF THE VALVE.
4. REMOVE EXISTING RISER PIPE DOWN 18" AND REPLACE TO THE NEW ELEVATION USING NEW PIPE AND A COLLAR CASTING.
5. WHERE CAST IRON CASTINGS TO BE REMOVED REQUIRE EXCAVATION GREATER THAN 20" DEEP, CONTRACTOR TO FILL EXCAVATION WITH CONTROLLED LOW STRENGTH MATERIAL TO THE UNDERSIDE OF THE CONCRETE PAVEMENT PATCH.
6. REINFORCING STEEL SHALL MEET SPECIFICATIONS.
7. CONCRETE DIAMOND SHALL BE INSTALLED BELOW HMAC IN CITY OF NEW BRAUNFELS ROW.

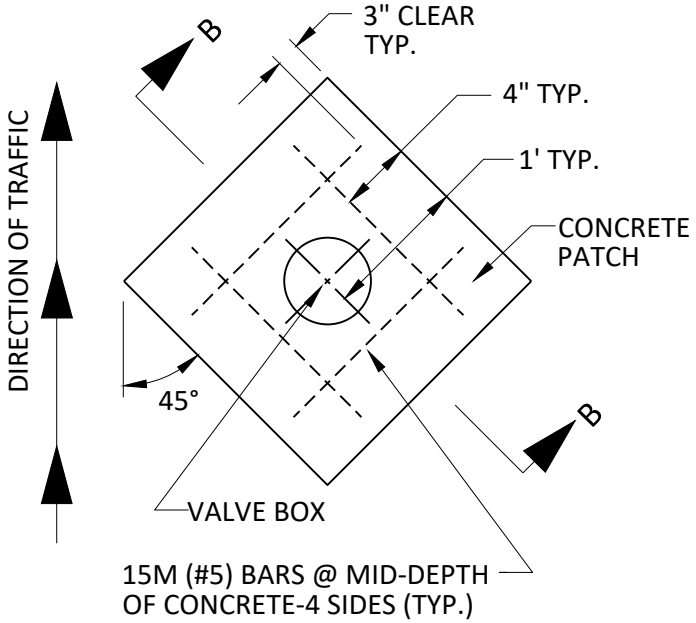

PLAN VIEW

NBU® NEW BRAUNFELS UTILITIES WATER SYSTEMS ENGINEERING	DRAWN BY: EWL	STANDARD DRAWING: WATER VALVE BOX ADJUSTMENT TO GRADE W/FULL DEPTH CONCRETE FOR EXISTING STREETS			
	APPROVED BY: A. WILLARD				
	DRAWING DATE: 2/1/24	UPDATED:	SCALE: N.T.S.	SHEET: 1 OF 1	DRAWING NO. 232